

Model 600XL3

400 psi

15 psi to 75 psi

140° F

Water Pressure Reducing Valve with Integral Strainer

Application

Zurn Wilkins model 600XL3 designed for installation on potable water lines to reduce high inlet pressure to a lower outlet pressure. The integral strainer makes this device ideal for residential and commercial water systems requiring frequent cleaning because of sediment and debris. The patented integral venturi enables best-in-class flow performance, making sizing easier and providing the user ideal water pressure at higher flow rates. The integral by-pass prevents buildup of excessive system pressure caused by thermal expansion. The balanced piston design enables the pressure reducing valve to react in a smooth and responsive manner to changes in system flow demand, while at the same time, providing protection from inlet pressure changes. A removable cartridge and cost-effective repair kits significantly reduce maintenance time and costs. The valve includes premium stainless steel internals as standard to provide enhanced corrosion resistance and lasting durability.

Standards Compliance

- ASSE® Listed 1003
- cUPC® Listed
- CSA® Certified B356
- Meets the requirements of NSF/ANSI/CAN 61 & 372

Materials

Low lead cast bronze ASTM B806 Main valve body Bell housing Low lead cast bronze ASTM B806

Fasteners Stainless steel, 300 series Stem Stainless steel, 300 series Plunger Stainless steel, 300 series Buna Nitrile (FDA approved) Elastomers

EPDM (FDA approved) Stainless steel, 300 series

Springs Cartridge NorvI™

Features

Sizes: 3/4", 1", 11/4", 11/2", 2" Maximum working water pressure Maximum working water temperature Reduced pressure range

Factory preset 50 psi Threaded connections (FNPT)

ANSI B1.20.1 Copper connections (Female) ANSI B16.22

Options (Suffixes can be combined)

standard with single union FNPT inlet x FNPT

outlet

double union FNPT x FNPT \Box DU

□ DUC double union Copper Sweat x Sweat \Box C single union Copper Sweat x FNPT

 \square HR high range, outlet adjust from 60 psi to 125 psi

 \Box G with gauge

□ 625XL3 competitor replacement model


Accessories

☐ Repair kits

☐ By-Pass Valve: (Fittings not included, to be plumbed in

parallel). *See Inst. on page 3

1-600XL3DUBP & 1-600XL3DUHRBP




Dimensions & Weights (do not include pkg.)

SIZE		CONNECTIONS	DIMENSIONS (approximate)								WEIGHT	
			Α		В		С		D		WEIGHT	
in.	mm		in.	mm	in.	mm	in.	mm	in.	mm	lbs.	kg.
3/4	20	SINGLE UNION	5 1/4	133	4 3/4	121	11/2	38	1 3/4	44	2.0	0.9
3/4	20	DOUBLE UNION	6	152	4 3/4	121	11/2	38	1 3/4	44	2.3	1.0
1	25	SINGLE UNION	6 1/8	156	5 3/8	137	11/2	38	2 3/4	70	3.6	1.6
1	25	DOUBLE UNION	7	178	5 3/8	137	11/2	38	2 3/4	70	4.1	1.8
11/4	32	SINGLE UNION	7 1/4	184	6 7/16	164	2	51	2 3/4	70	4.9	2.2
11/4	32	DOUBLE UNION	8 3/8	213	6 7/16	164	2	51	2 3/4	70	5.6	2.6
11/2	40	SINGLE UNION	8 3/4	222	7 1/2	191	2 1/8	54	4 9/16	116	9.8	4.5
11/2	40	DOUBLE UNION	10	254	7 1/2	191	2 1/8	54	4 9/16	116	10.9	5.0
2	50	SINGLE UNION	10 1/4	260	7 1/2	191	2 1/2	64	4 9/16	116	12.2	5.5
2	50	DOUBLE UNION	11 1/2	292	7 1/2	191	2 1/2	64	4 9/16	116	13.7	6.2

Zurn Water, LLC | Wilkins

1747 Commerce Way, Paso Robles, CA U.S.A. 93446 Ph. 855-663-9876, Fax 805-238-5766

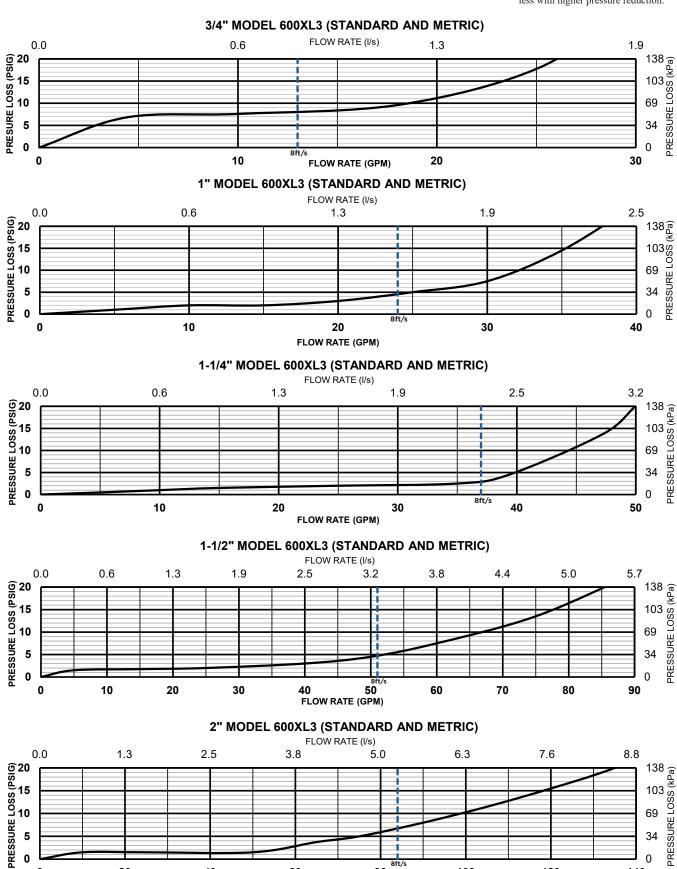

0

40

60

80

FLOW RATE (GPM)

100

120

20


140


Typical Installation

Local codes shall govern installation requirements. Unless otherwise specified, the assembly shall be mounted in accordance with the manufacturer's instructions and the latest edition of the Uniform Plumbing Code. The assembly shall be installed with sufficient side clearance for testing and maintenance. The Model 600XL3 may be installed in any position. Multiple installations in series are required when the desired pressure reduction is more than 3 to 1 (i.e. 150 psi inlet reduced to 50 psi outlet). Due to highly efficient flow performance, only use the 600XL3DUBP as low flow bypass valve options. Typical 600XL3 installations do not require a bypass valve for effective low flow capability.

Caution: Anytime a pressure reducing valve is adjusted, a pressure gauge must be used downstream to verify correct pressure setting. Do not bottom-out adjustment bolt on bell housing.

TYPICAL INSTALLATION

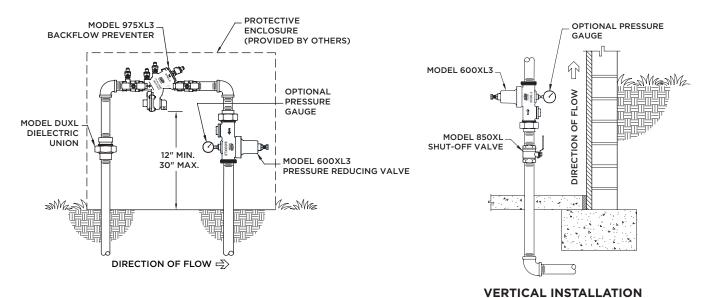

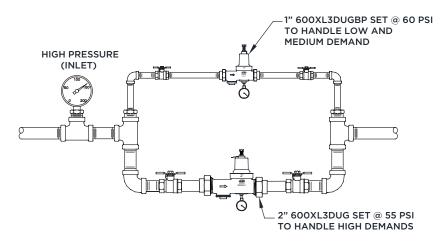

DIRECTION OF FLOW ⇒

PARALLEL INSTALLATION

Specifications

The Pressure Reducing Valve shall be certified to NSF/ANSI/CAN 61 & 372, consisting of a low lead cast bronze body, bronze bell housing, and a bolt to adjust the downstream pressure. The bronze bell housing shall be threaded to the body. The assembly shall be a balanced piston design and shall reduce pressure in both flow and no-flow conditions and maintain less than 10 psi drop from set pressure up to a flow rate of 8 ft/s. The assembly shall be accessible for maintenance without having to remove the body from the line. The assembly shall include a removable cartridge and stainless steel corrosion resistant hardware and stem. The Pressure Reducing Valve shall be a ZURN WILKINS Model 600XL3.